ALL REQUIRED LABELS SHALL BE CAPITOLIZED WHITE LETTERING 3/8" IN HEIGHT ON A REFLECTIVE, RED BACKGROUND AND BE SUITABLE FOR THE ENVIRONMENT. 2013 CRC 331.2.1

ARRAY(S)	
JUNCTION BOXES/ CONDUIT	3
D/C DISCONNECT	1, 2
UTILITY INTERACTIVE INVERTER	1, 5, 8
SUB-PANEL/ LOAD CENTER	1
A/C DISCONNECT	1
MAIN SERVICE PANEL	1, 2, 4, 6, 8, 9, 10 (7 FOR A/C SYSTEMS)

SOLAR SUBMITTAL AND INSPECTION REQUIREMENTS FOR THE CITY OF LINCOLN

Interior inspections are needed for Carbon Monoxide detector installation and the attic area may need to be accessed for lag Screw mounting penetration.

the main service panel will need to be labeled for solar equipment locations when they are place behind fences, in the garages or on another wall line other than the main service panel.

All exterior exposed conduits are required to be painted and labeled

2013 CEC 705.10

#10

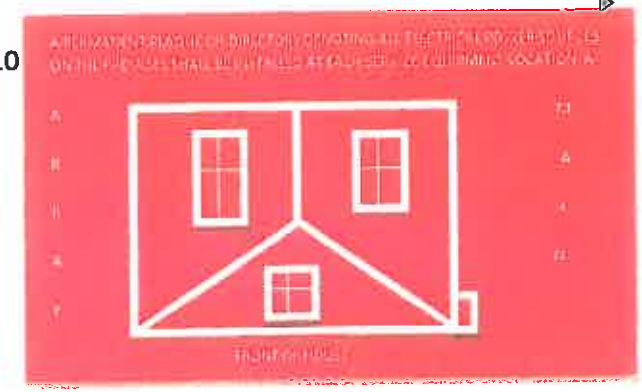

OR

2013 CEC 690.14 (C) (2)

#1

2013 CEC 690.17

#2

2013 CEC 690.31(E) (3)

#3

2013 CEC 705.10

#4

2013 CEC 690.5 (C)

#5

2013 CEC 705.12(D) (7)

#6

2013 CEC 690.52

#7

2013 CEC 690.54

#9

2013 CEC 690.53

#8